


A  
B  
C  
D  
E  
F  
G  
H

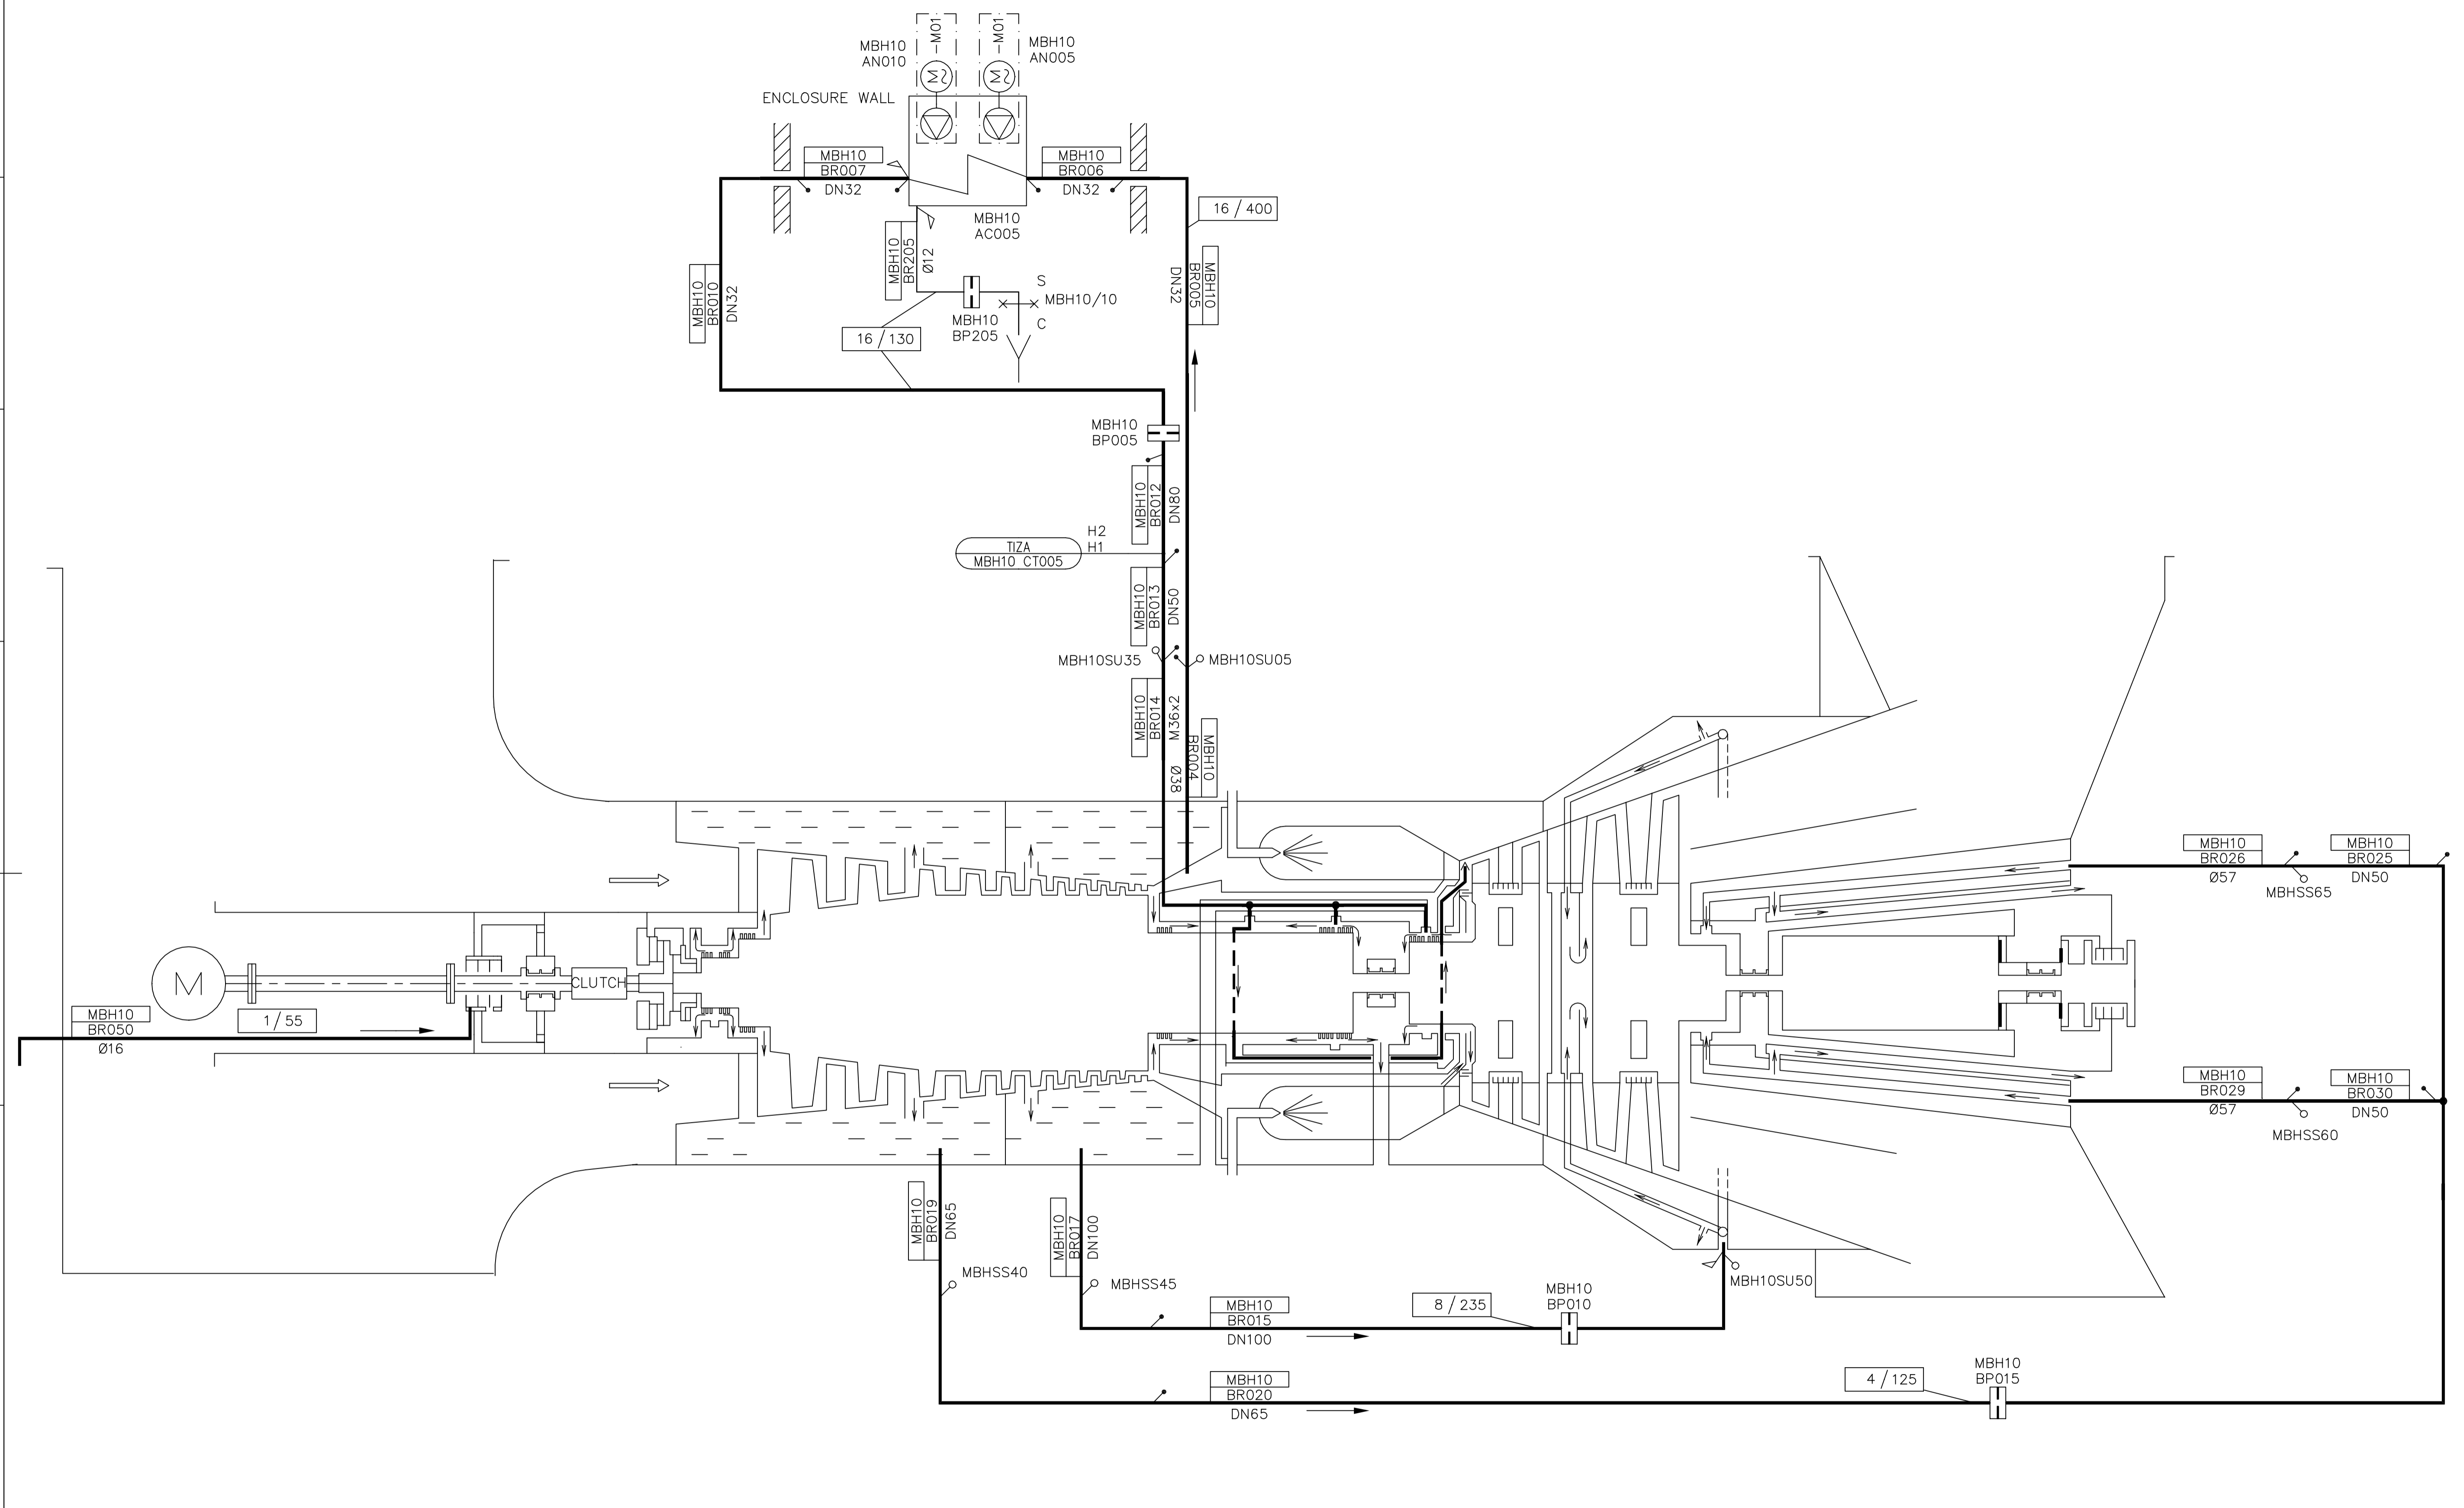

LEGEND FOR SYMBOLS

- X DELIVERY LIMIT:
- C=CUSTOMER
- S=SIEMENS
- PIPE LIMIT
- SYSTEM LIMIT
- DESIGN DATA LIMIT

- B926 = UNIT 01
- B927 = UNIT 02
- B925 = UNIT 03
- B4516 = UNIT 04
- B4518 = UNIT 05
- B4555 = UNIT 06
- B4556 = UNIT 07
- B4557 = UNIT 08
- B4558 = UNIT 09

M FB 103  
PHASE 0

bar(g)/°C

b	B-NUMBERS AND UNIT NUMBERS ADDED	05.03.01	GA/SM
Latest rev.	Revision text	Rev. date	Prepared by

Original Date 03.11.13	Based on Doc. No / Latest revision 992873 / 5	Title COOLING / SEALING AIR SYSTEM	
Appr. by 2005-03-03 Fredrik Andersson	Designation MBH10	Order No. B4516	Plant or type YAMAMA CEMENT
Checked by 2005-03-03 Göran Andersson	Prepared by ULHO/M.EKMAN	Responsible dept. GPML	Document No. 2046020
Latest revision b	Archive	Order No. B4516	Plant or type YAMAMA CEMENT
HC 9100			Document No. 2046020



Lang. E	No. of sh. 1
Sheet 1	

We reserve all rights in this document and its contents. No part of this document may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Siemens Aktiefond AB.