


A
B
C
D
E
F
G
H

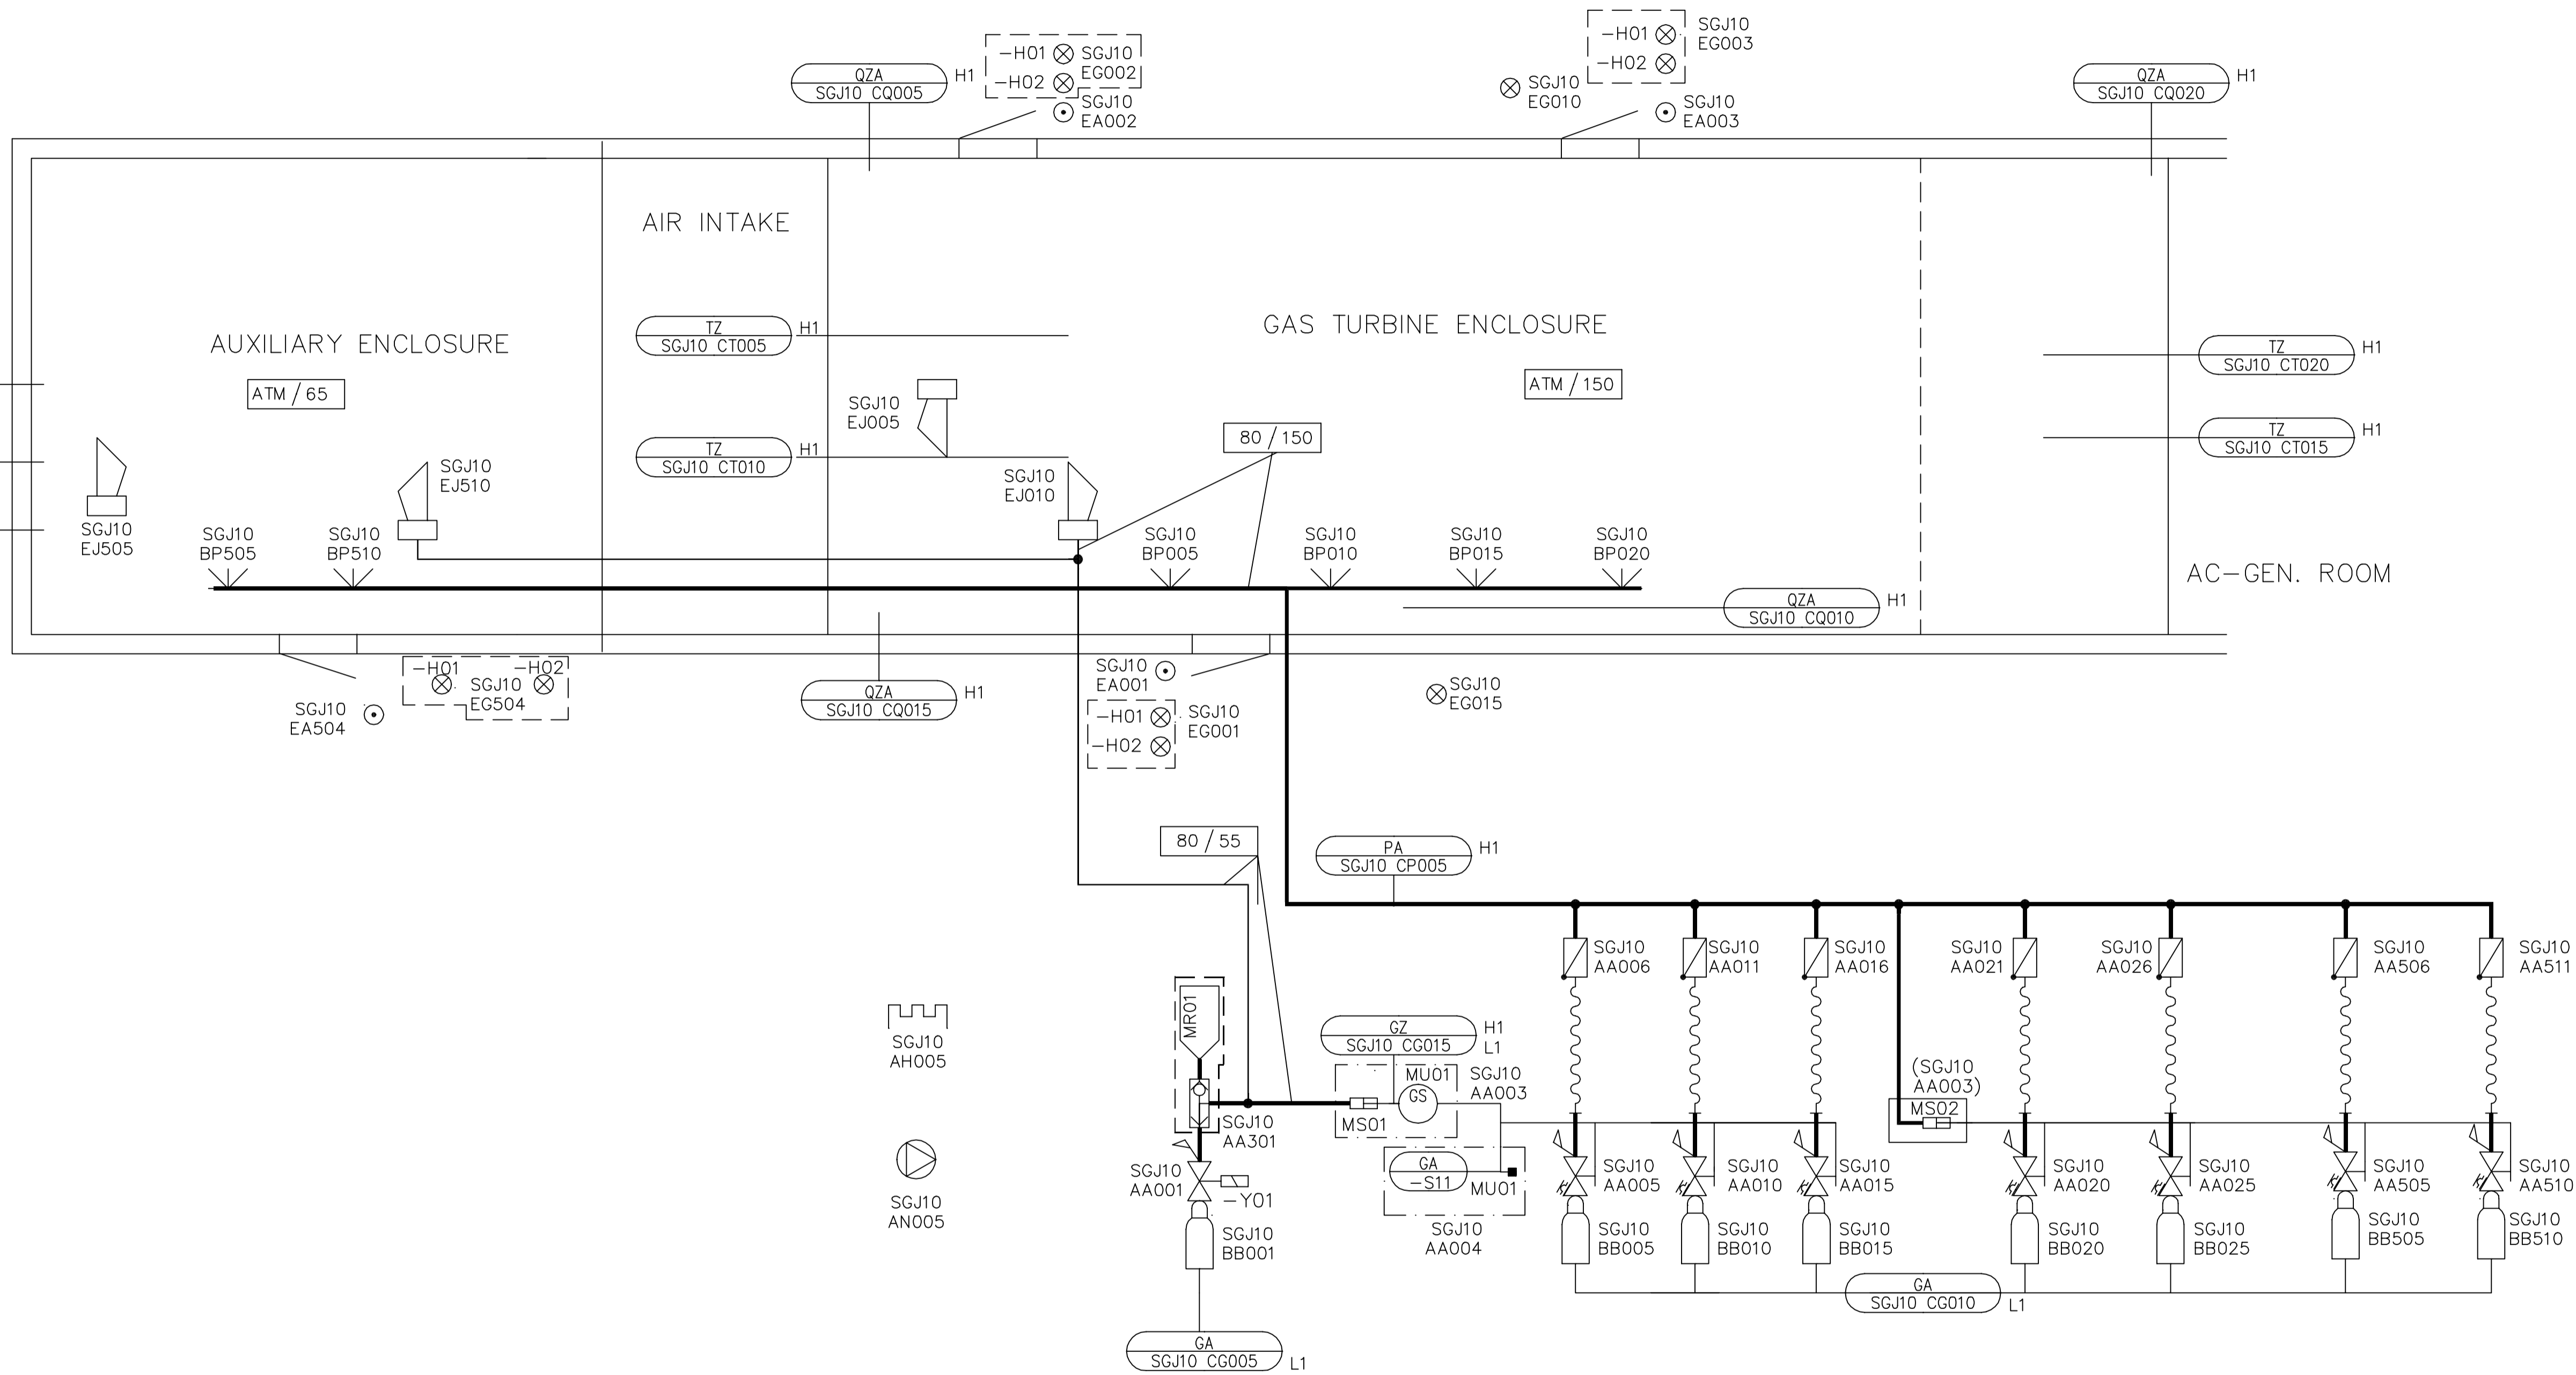

We reserve all rights in this document and its contents. No part of this document may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Siemens Aktiengesellschaft, Munich, Germany.

c	SHEET MODIFIED	05.12.13	GA/SM
Latest rev.	Revision text	Rev. date	Prepared by

Original Date	Based on Doc. No / Latest revision	Title	
03.11.13	992895 / 6	FIRE EXTINGUISHING SYSTEM CO2	
Appr. by 2005-03-04 Fredrik Andersson	Designation SGJ	Order No. B4516	Plant or type YAMAMA CEMENT
Checked by 2005-03-04 Göran Andersson	Prepared by ULHO/O.KÜLBEL		
Latest revision c	Archive —	Resp. dept. GPML	Document No. 2046036
HG 9100	SIEMENS		No. of sh. 1 Sheet 1

M FB 103
PHASE 0

